

NOTES


All information contained within this document subject to change without notice.

include sensor operated activation with a 20 second maximum run time. Bottle counter display indicates the number of 16 oz plastic bottles saved as well as the ounces of water dispensed for water consumption tracking. White light indicates the water filter status. Unit shall include LED lights that illuminate the bottle filling area. Bottle filler housing construction shall be stainless steel. Bottle filler shall provide up to 1.2 gpm flow rate with a laminar flow. Cabinet door shall have swing-open mechanism, providing easy access for filter replacement. Filter used in the unit shall have capacity of 3000 gallons at a minimum, and shall reduce PFOA, PFOS, lead, microplastic, cyst, chlorine and class 1 particles.

DOWNLOADS

- [DRS100-REF Stand Alone Refrigerated Bottle Filler Installation Instructions](#)
- [DRS100-UNREF Stand Alone Unrefrigerated Bottle Filler Installation Instructions](#)
- [FA3000-DRS100 Filter Assembly Installation Instructions](#)
- [RC8000 Remote Chiller for DRS-100 Bottle Filler Installation Instructions](#)
- [FC3000 Replacement Water Filter Cartridge Installation Instructions](#)
- [Additional Downloads](#)

ROUGH-IN

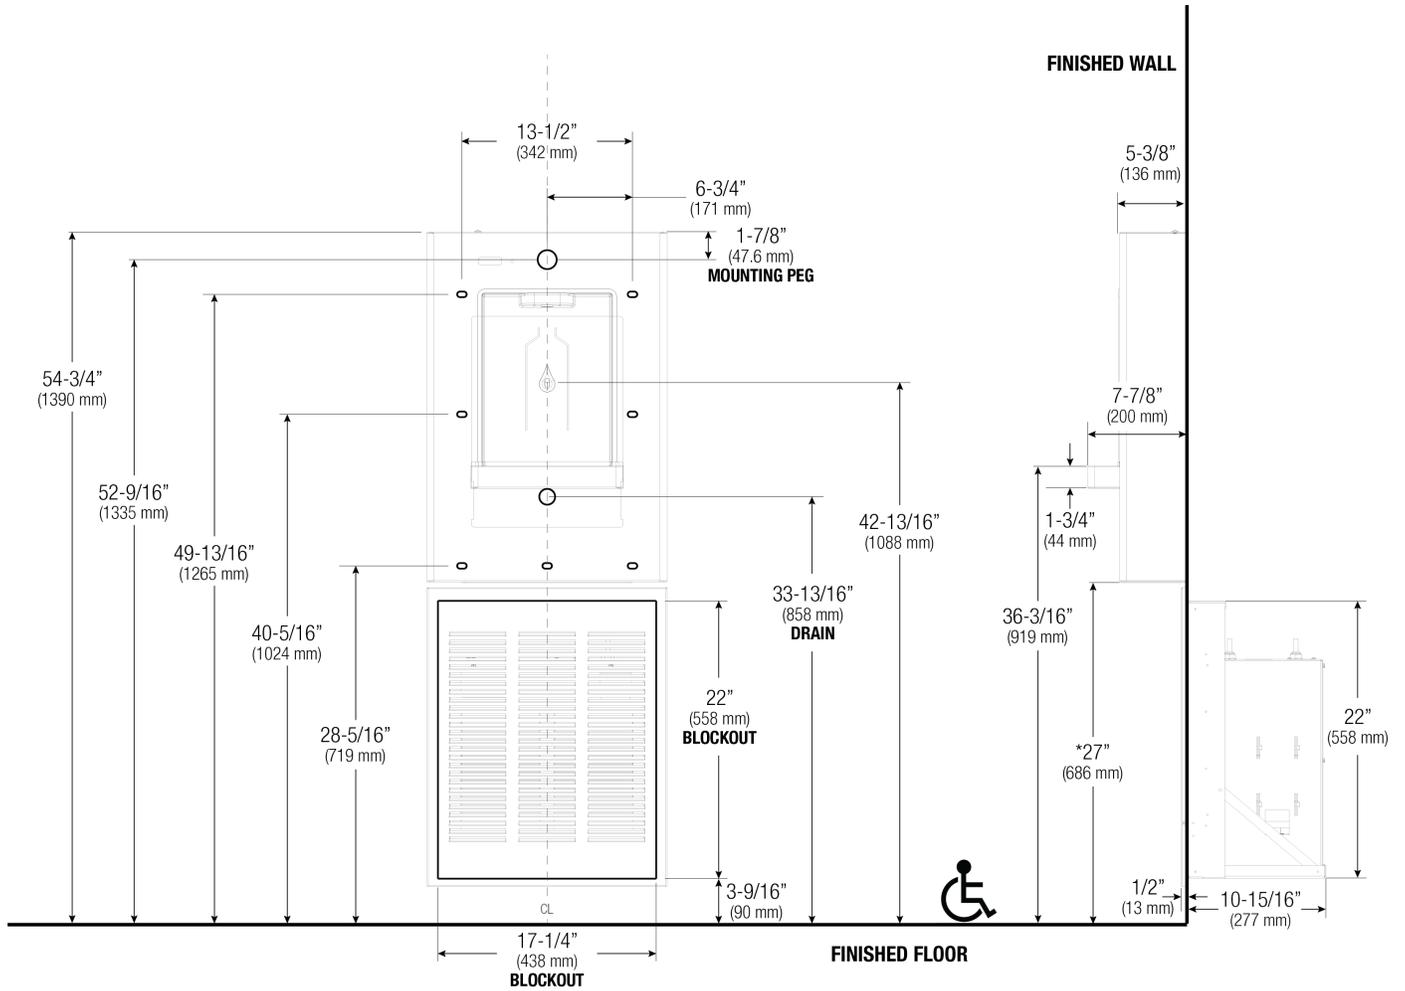

Sloan 10500 Seymour Ave, Franklin Park, IL 60131
Phone: 800.982.5839 • Fax: 800.447.8329 • sloan.com